


REQUIRED WHEN A SEPARATE TRENCH OR A TEN FOOT (10') MINIMUM SEPARATION IS NOT POSSIBLE.
REFER TO THE STANDARD SPECIFICATIONS FOR WATER AND SEWER MAIN CONSTRUCTION IN ILLINOIS.

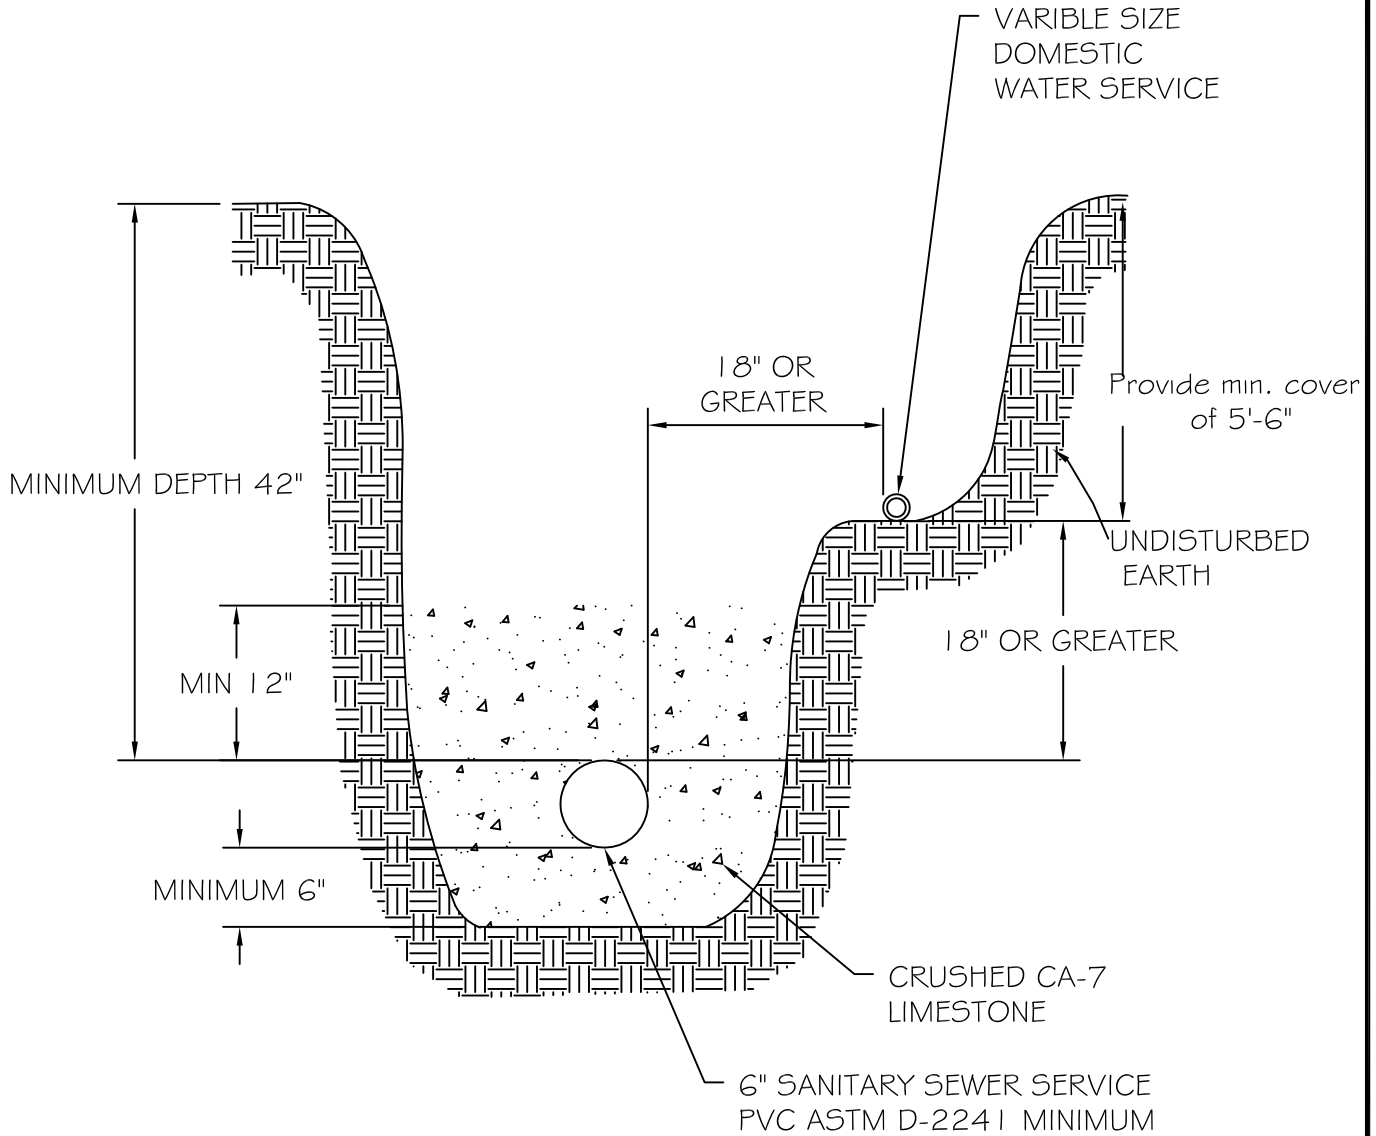

REVISIONS

DATE: 01/2011	BY: jhs

SANITARY AND WATER SERVICE SEPARATION

SCALE: NOT TO SCALE	CHECKED: DF	DRAWING NUMBER
DATE: 1/04	DRAWN: NM	EXHIBIT III-C-2