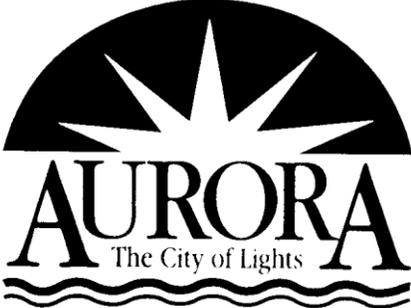


DEMO – DEMOLITION - APPLICATION FORM

(Demolition of Entire Structures, Residential or Commercial, for Selective demolition use Remodeling Application)

FOR OFFICIAL USE ONLY PERMIT APPLICATION NO <div style="font-size: 2em; font-weight: bold; margin-left: 20px;">1</div> _____ SUBMITTED _____ / _____ / _____ NOTIFIED _____ / _____ / _____ ZONING _____	TOTAL FEE _____ WEB www.aurora-il.org FAX (630) 256-3139 TELEPHONE (630) 256-3130	 <p style="text-align: center;">DIVISION OF BUILDING & PERMITS 65 WATER STREET AURORA, ILLINOIS 60505</p>
--	--	--

LAND / PARCEL INFORMATION

PROPERTY ADDRESS _____

SUBDIVISION _____ UNIT / PHASE # _____ LOT # _____

COUNTY <input type="checkbox"/> KANE (CHECK ONE) <input type="checkbox"/> KENDALL	<input type="checkbox"/> DuPAGE <input type="checkbox"/> WILL	TOWNSHIP (CIRCLE ONE)	11 12 04 14 15 07 03 01	TOWNSHIP SECTION # _____ If project involves new construction in DuPage County -- Impact Tax must be Paid	BLOCK # (if known) _____ LOT# (if known) _____
--	--	--------------------------	-------------------------------	--	--

(Call tax assessor's office with questions)

PROPERTY OWNER & CONTACT
 Contact Name _____
 OWNER'S ADDRESS _____
 PHONE # () _____
 FAX # () _____
 E-MAIL _____

TENANT & CONTACT
 Contact Name _____
 ADDRESS _____
 PHONE # () _____
 FAX # () _____
 E-MAIL _____

ZONING INFORMATION

Zoning (CHECK ONE)	<input type="checkbox"/> R-1	<input type="checkbox"/> R-2	<input type="checkbox"/> R-3	<input type="checkbox"/> PDD
Classification	<input type="checkbox"/> R-4	<input type="checkbox"/> R-4A	<input type="checkbox"/> R-5	<input type="checkbox"/> R-5A
	<input type="checkbox"/> B-1	<input type="checkbox"/> B-2	<input type="checkbox"/> B-3	<input type="checkbox"/> B-B
<input type="checkbox"/> SPECIAL USE (CHECK IF APPLICABLE)	<input type="checkbox"/> M-1	<input type="checkbox"/> M-2	<input type="checkbox"/> O	<input type="checkbox"/> ORI
	<input type="checkbox"/> O	<input type="checkbox"/> ORI	<input type="checkbox"/> RD	<input type="checkbox"/> PDD
	<input type="checkbox"/> DC	<input type="checkbox"/> DF	C.O.A. Required	


CERTIFICATION

This is an application only. Completion of this application does Not entitle the commencement of work.. I understand that the approval of this application and issuance of a permit does not obviate the need to comply with all applicable laws and ordinances. I agree to hold harmless and indemnify the City of Aurora for any claim against the City as the result of any act of commission or omission by or on behalf of the undersigned, his/her agent, principle, contractor, subcontractor or supplier. I the undersigned am the Owner or a duly contracted representative of the owner of said property.

GENERAL CONTRACTOR
 CITY OF AURORA
 G.C. REGISTRATION # _____ - _____

BUSINESS NAME _____
 CONTACT NAME _____
 ADDRESS _____
 CITY, STATE ZIP _____
 N/A PHONE () _____ - _____
 FAX () _____ - _____
 E-MAIL _____

CONTRACTOR _____ (PRINT)
CONTRACTOR _____ (SIGNATURE)
 OR
OWNER _____ (PRINT)
OWNER _____ (SIGNATURE)

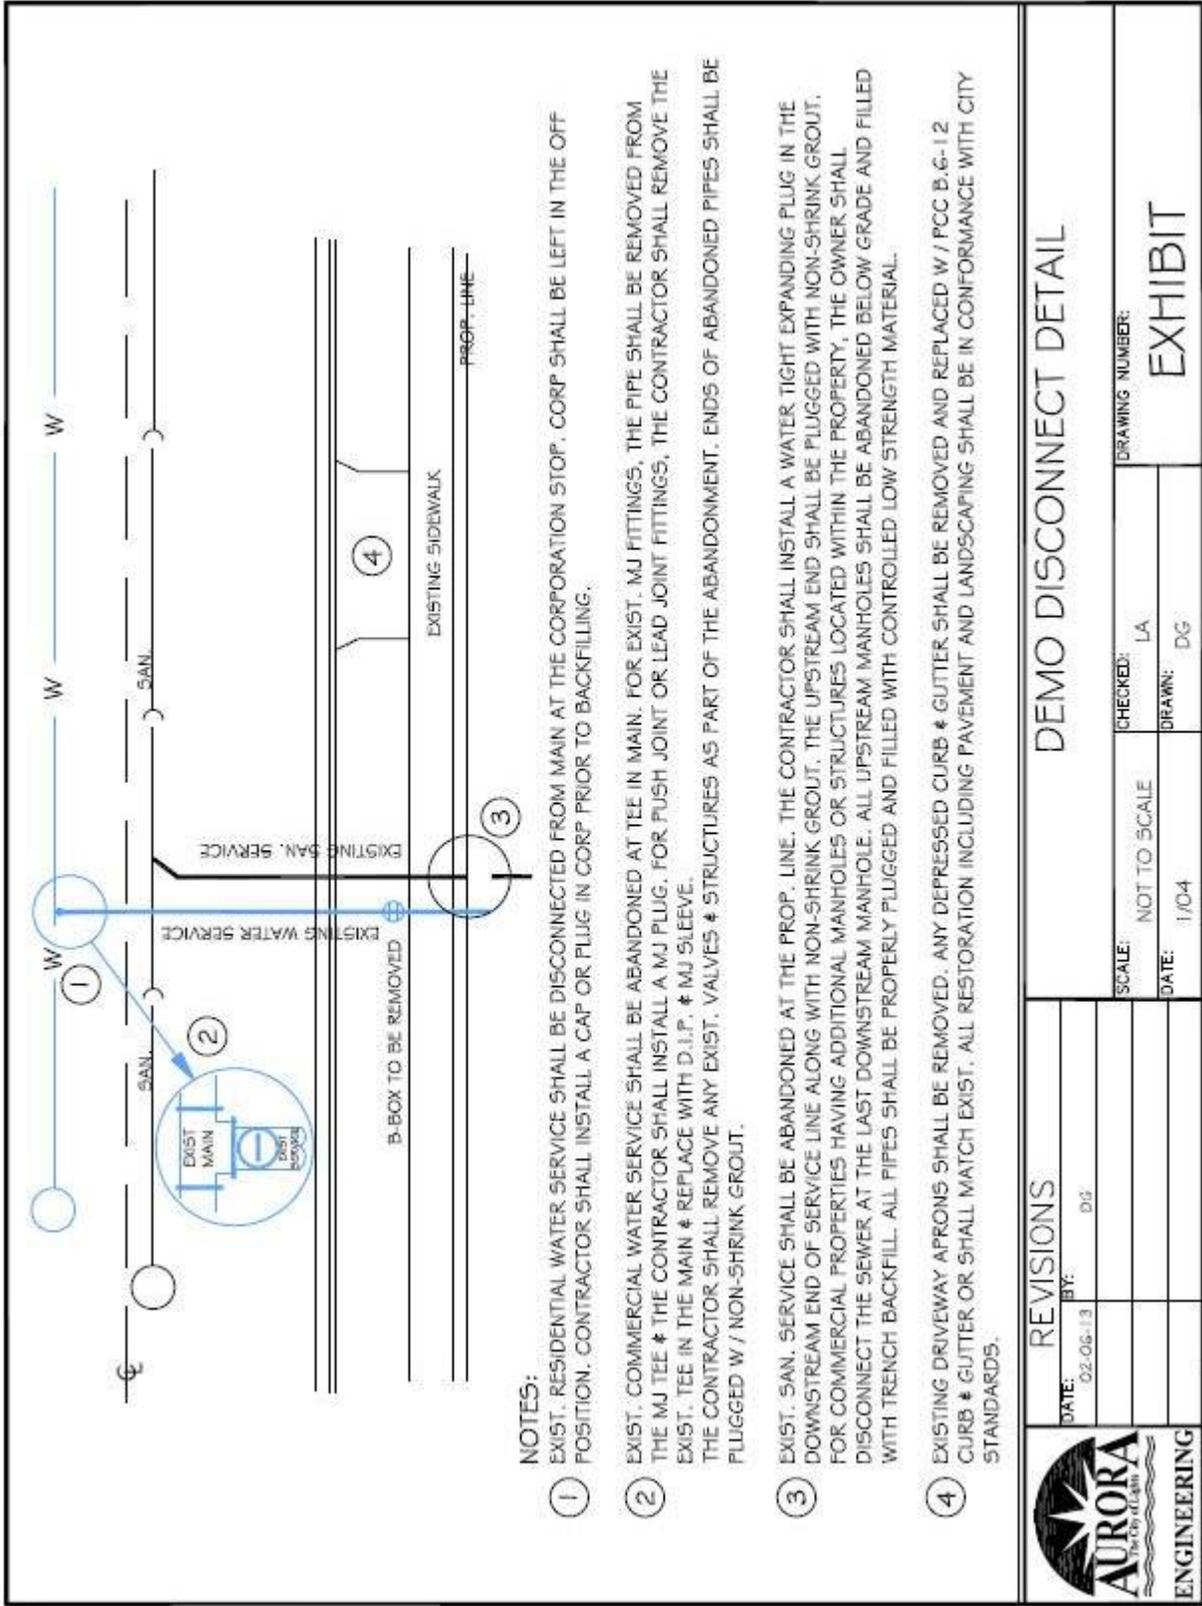

NOTES:

- ① EXIST. RESIDENTIAL WATER SERVICE SHALL BE DISCONNECTED FROM MAIN AT THE CORPORATION STOP. CORP SHALL BE LEFT IN THE OFF POSITION. CONTRACTOR SHALL INSTALL A CAP OR PLUG IN CORP PRIOR TO BACKFILLING.
- ② EXIST. COMMERCIAL WATER SERVICE SHALL BE ABANDONED AT TEE IN MAIN. FOR EXIST. MJ FITTINGS, THE PIPE SHALL BE REMOVED FROM THE MJ TEE & THE CONTRACTOR SHALL INSTALL A MJ PLUG. FOR PUSH JOINT OR LEAD JOINT FITTINGS, THE CONTRACTOR SHALL REMOVE THE EXIST. TEE IN THE MAIN & REPLACE WITH D.I.P. & MJ SLEEVE. THE CONTRACTOR SHALL REMOVE ANY EXIST. VALVES & STRUCTURES AS PART OF THE ABANDONMENT. ENDS OF ABANDONED PIPES SHALL BE PLUGGED W / NON-SHRINK GROUT.
- ③ EXIST. SAN. SERVICE SHALL BE ABANDONED AT THE PROP. LINE. THE CONTRACTOR SHALL INSTALL A WATER TIGHT EXPANDING PLUG IN THE DOWNSTREAM END OF SERVICE LINE ALONG WITH NON-SHRINK GROUT. THE UPSTREAM END SHALL BE PLUGGED WITH NON-SHRINK GROUT. FOR COMMERCIAL PROPERTIES HAVING ADDITIONAL MANHOLES OR STRUCTURES LOCATED WITHIN THE PROPERTY, THE OWNER SHALL DISCONNECT THE SEWER AT THE LAST DOWNSTREAM MANHOLE. ALL UPSTREAM MANHOLES SHALL BE ABANDONED BELOW GRADE AND FILLED WITH TRENCH BACKFILL. ALL PIPES SHALL BE PROPERLY PLUGGED AND FILLED WITH CONTROLLED LOW STRENGTH MATERIAL.
- ④ EXISTING DRIVEWAY APRONS SHALL BE REMOVED. ANY DEPRESSED CURB & GUTTER SHALL BE REMOVED AND REPLACED W / PCC B.6-12 CURB & GUTTER OR SHALL MATCH EXIST. ALL RESTORATION INCLUDING PAVEMENT AND LANDSCAPING SHALL BE IN CONFORMANCE WITH CITY STANDARDS.

REVISIONS	
DATE: 02-06-13	BY: DG

DEMO DISCONNECT DETAIL	
SCALE: NOT TO SCALE	CHECKED: LA
DATE: 1/04	DRAWN: DG
DRAWING NUMBER: EXHIBIT	

